
 3.375"	25" 2.125"	9.0"

Paene	JOB NO:         04062414         R1:           DATE:         7/1/04         R4:	R2: R5: R6:				
Flexographic Design and Prepress internet: www.pen-and-inc.com PLEASE REVIEW THIS PROOF for copy, content, dimensional layout, color break, bar code, metallic areas (if applicable), etc. Your signature confirms and approves accuracy of the graphics and al information. Pen and Inc. of Milwaukee, Inc. will not be responsible for any errors or omissions after proco is approved with your signature. LIMITATION OF LIABILITY: This proof must be thoroughly inspected upon receipt of the same. It is the	APPROVED AS SHOWN	PROOF IS NOT DISTORTED PROOF IS DISTORTED PROOF IS CUTBACK	PANTONE PANTONE 520 3395	PANTONE 143	PANTONE 7499	
responsibility of the recipient to examine all proofs, films, engravings and plates prior to approval and printing. If errors are found on this proof, please contact our Customer Service Department. The liability of Pen and Inc. of Milwaukee, Inc. shall be limited to correcting or replacing it's own product. Pen and Inc. of Milwaukee, Inc. will not be liable for any other loss or damage including but not limited to the cost of proofs, negatives, engravings, printing plates or cylinders, overtime, press delays or downtime, and/or missing insertion dates.		PROOF SIMULATES PRESS GAIN DATE:	ONLY. PLE	ASE REFER TO	PROCESS MAGENTA ULATED FOR T O A PANTONE COLOR REPRE	E® COLOR



 01
 10
 20
 30
 40
 50
 60
 70
 80
 90
 100

diapers POSITION ONLY 000000000000000000000000000000000000			2.125	5" -
Indential       Rethraids for the formation of the			8.0"	12.2 CU' OFI
I ser ge ding the source of th			2.125	5"
9.0" 14.5"	2.125"	3.375"1.5"		1E ON

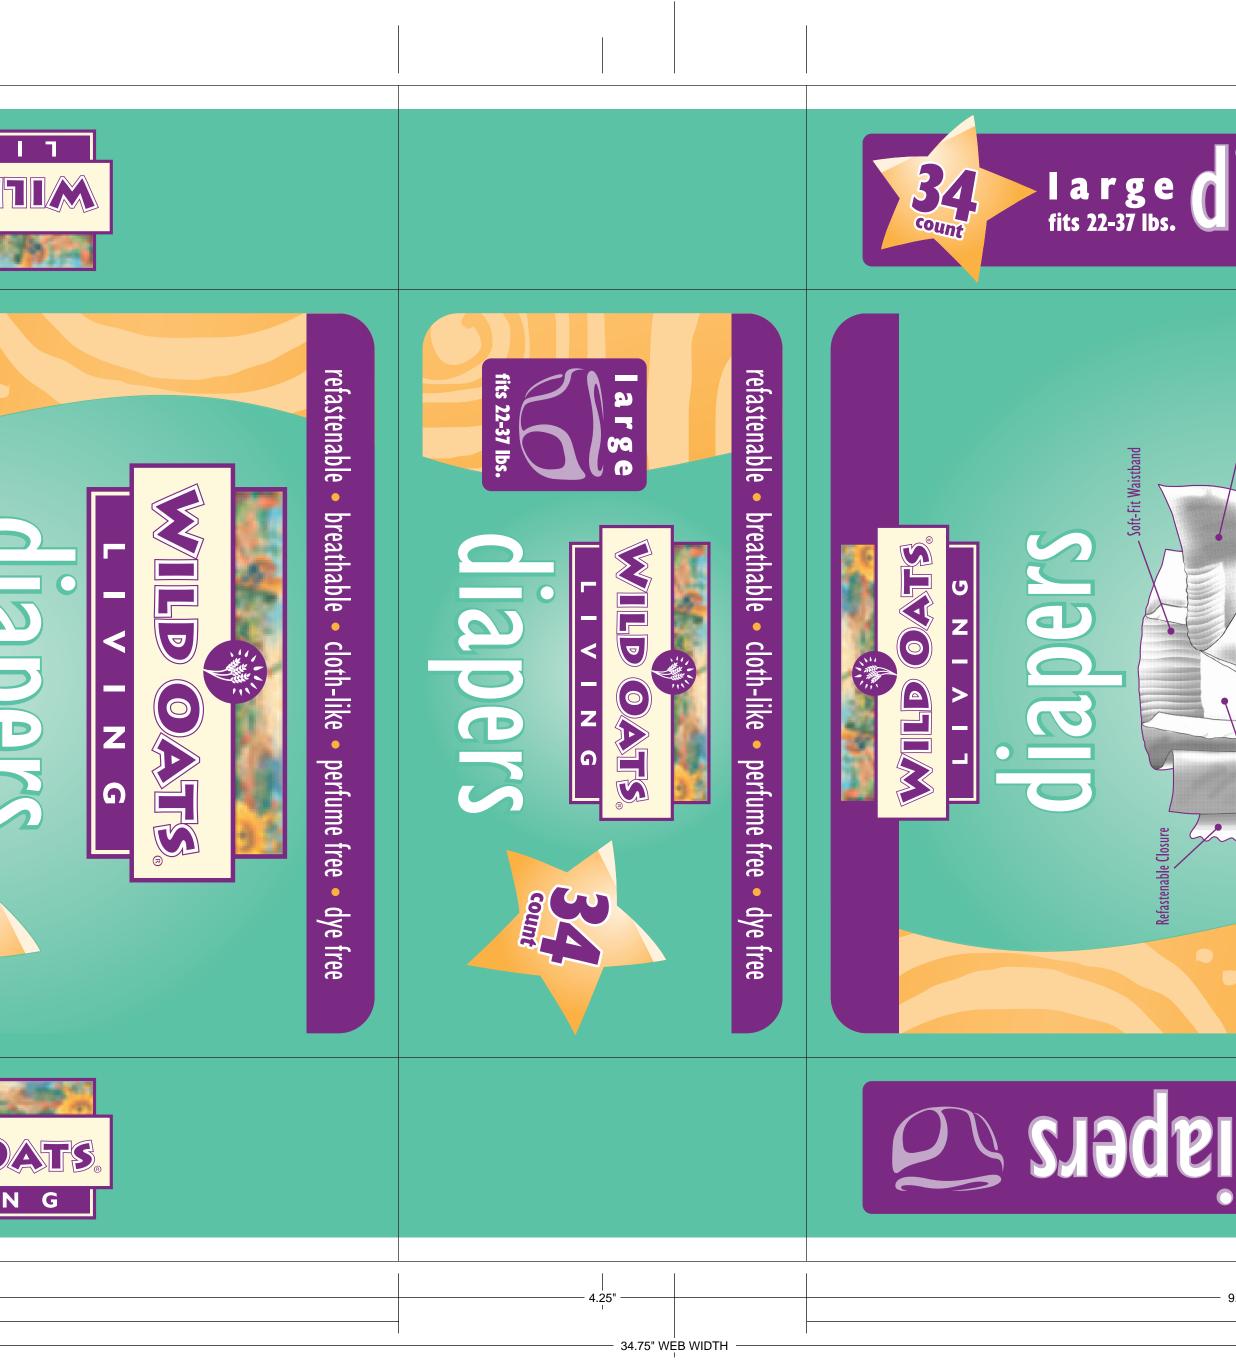